


INSTALLATION INSTRUCTIONS

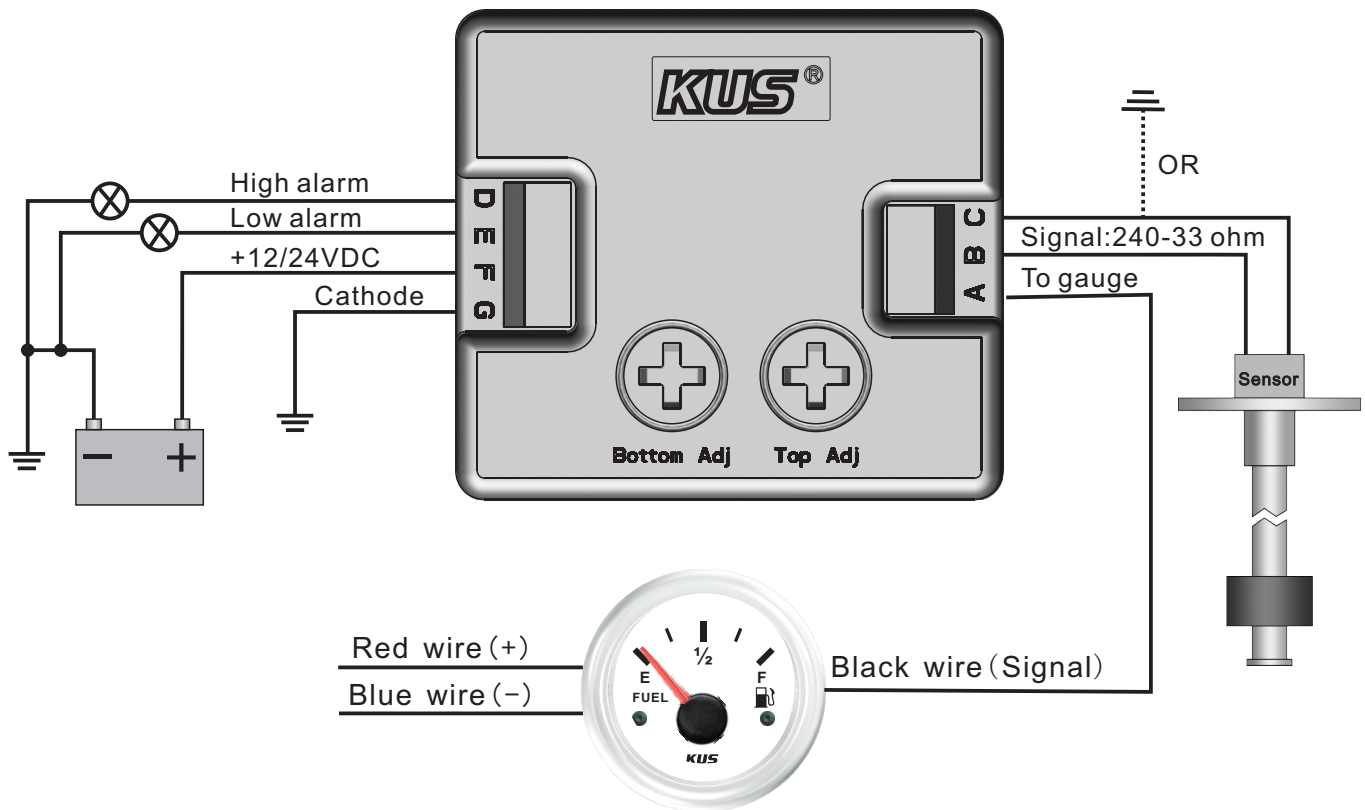

INSTALLATION STEPS

Assembly Instructions:

1. Lay SAB high/low level alarm in a flat position.
2. Connect wires according to instructions and alarm equipment. Ensure proper connection before debugging with power.
3. Slide float slowly from middle to top of SSS/SSL sensor and observe level that activates high alarm. In order to meet different needs of users, high alarm level can be adjusted by turning button “-Top Adj+” with an adjustable range of Full~3/4.
4. Slide float slowly from middle to bottom of SSS/SSL sensor and observe level that activates low alarm. In order to meet different needs of users, low alarm level can be adjusted by turning button “-Bottom Adj+” with an adjustable range of 1/4~Empty.
5. SAB high/low level alarm must be used together with 240-33ohm sensors. To get warning signals, SAB high/low level alarm must be used with sending units that allow alarm function.
6. The working load current of each one line outputting for alarm box should be 100mA.